


# CLOSED LOOP DRY FLUID COOLERS

Ref: 11433.04  
Date: 19 March 2001  
Cancels: 11433.05 dated  
1 January 1999

Air Solutions Group  
Davidson, NC 28036

## PUMP SELECTION

CHART 2

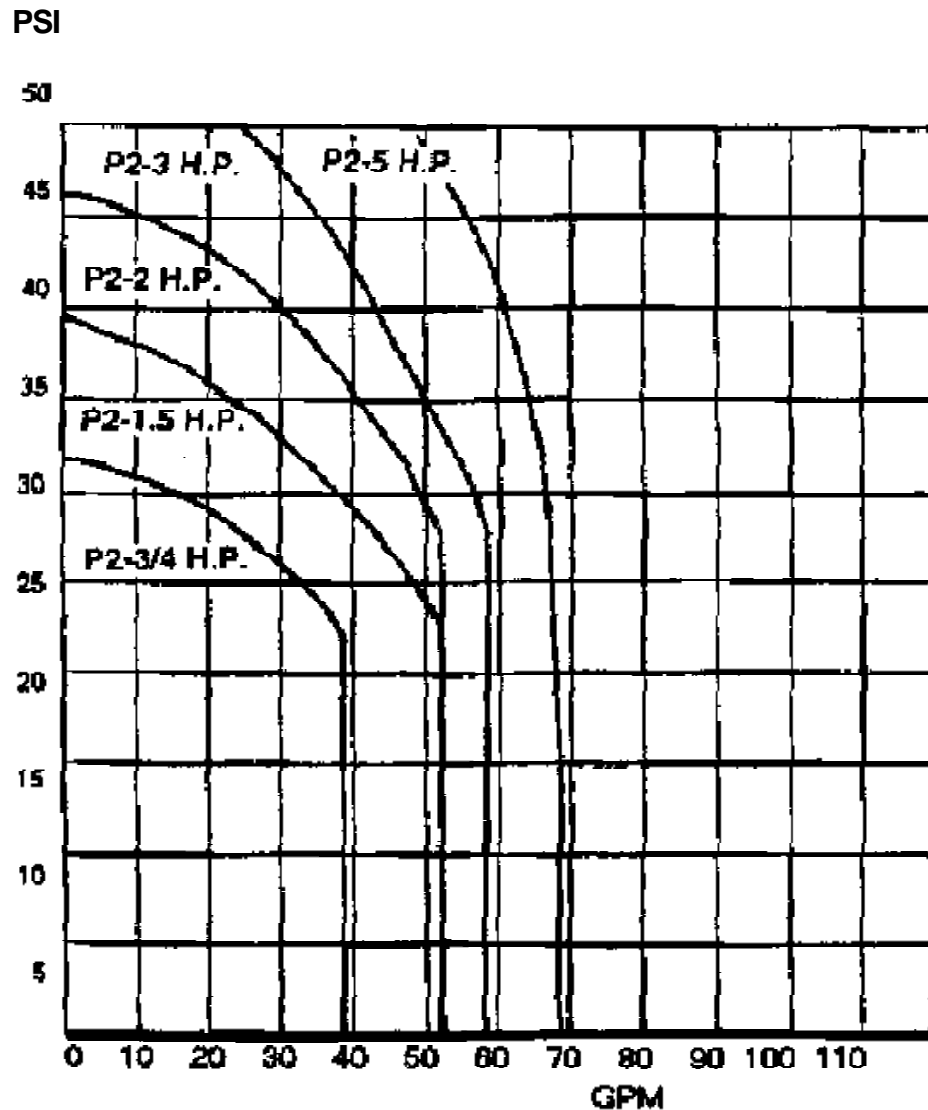

- Note:
- A) Curves based on 40% Glycol-60% Water Solution
  - B) For requirements above these curves consult Factory
  - C) P2 pumps are provided with "OPD" motors in a weather proof enclosure

