


CLOSED LOOP DRY FLUID COOLERS

Ref: 11435.04
Date: 19 March 2001
Cancels: 1 January 1999

Air Solutions Group
Davidson, NC 28036

DIMENSIONAL DATA

DUAL PUMP — DP3 - 3, 5, 7 1/2, 10 H.P.

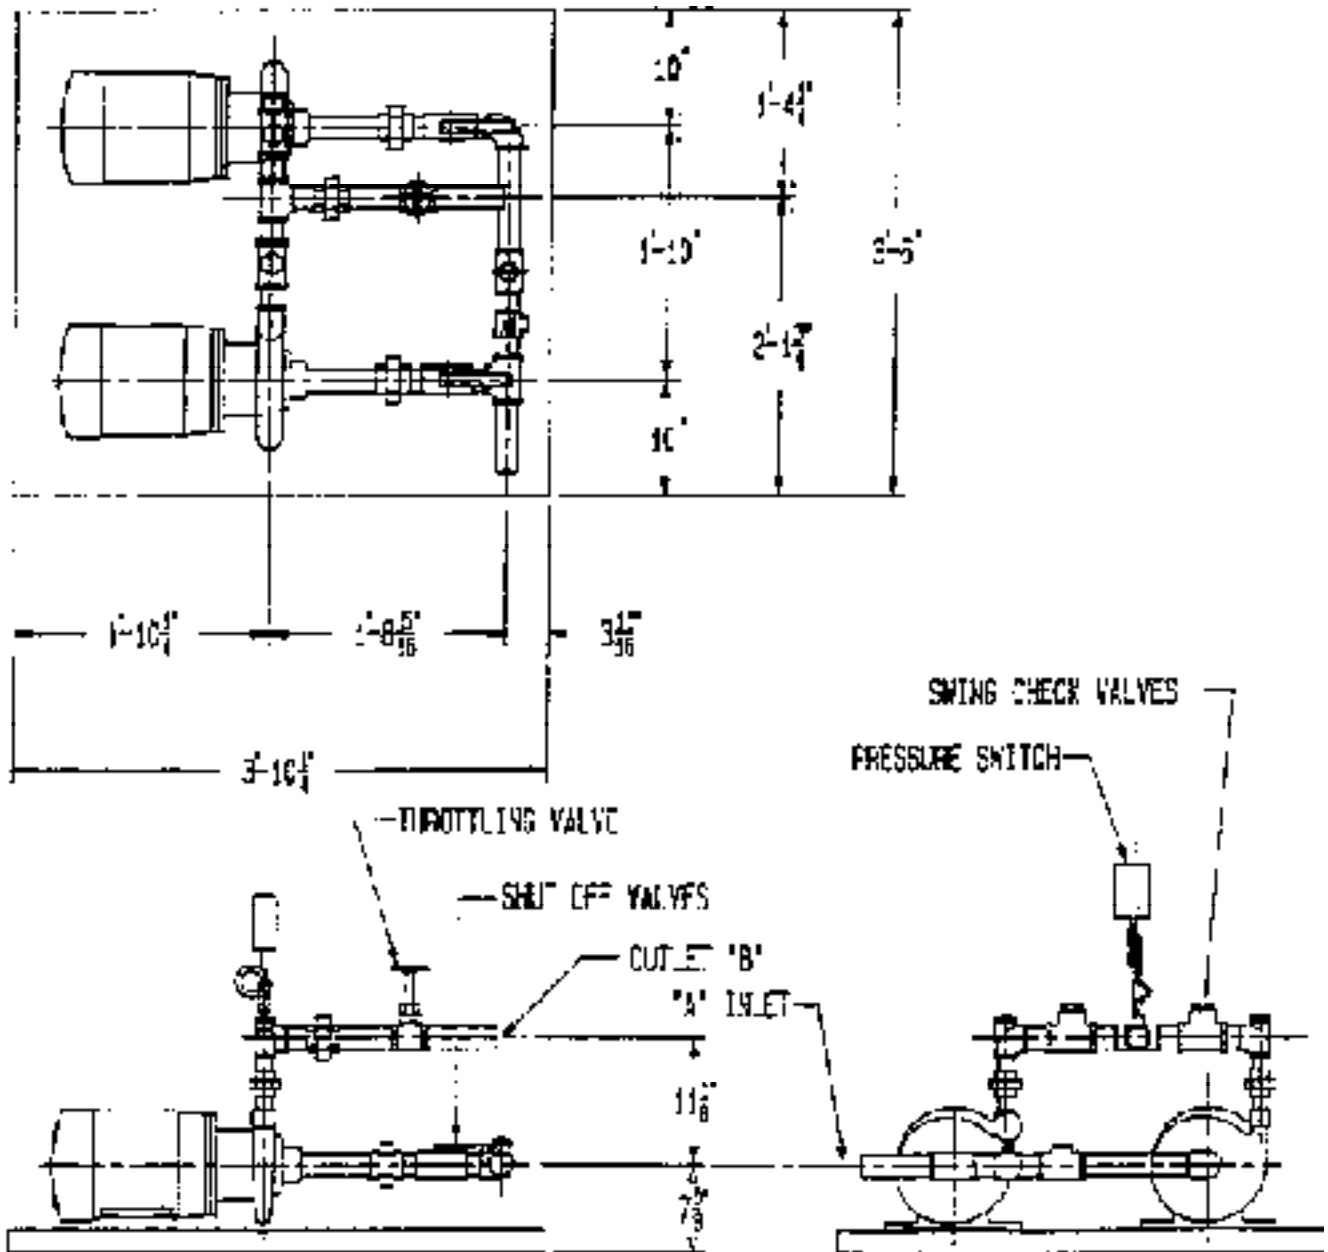

NOTE: Do not use for construction purposes.