




CLOSED LOOP DRY FLUID COOLERS

Air Solutions Group
Davidson, NC 28036

Ref: 11435.05
Date: 19 March 2001
Cancels: 1 January 1999

DIMENSIONAL DATA

SINGLE PUMP — P3 - 3, 5, 7 1/2, 10 H.P.

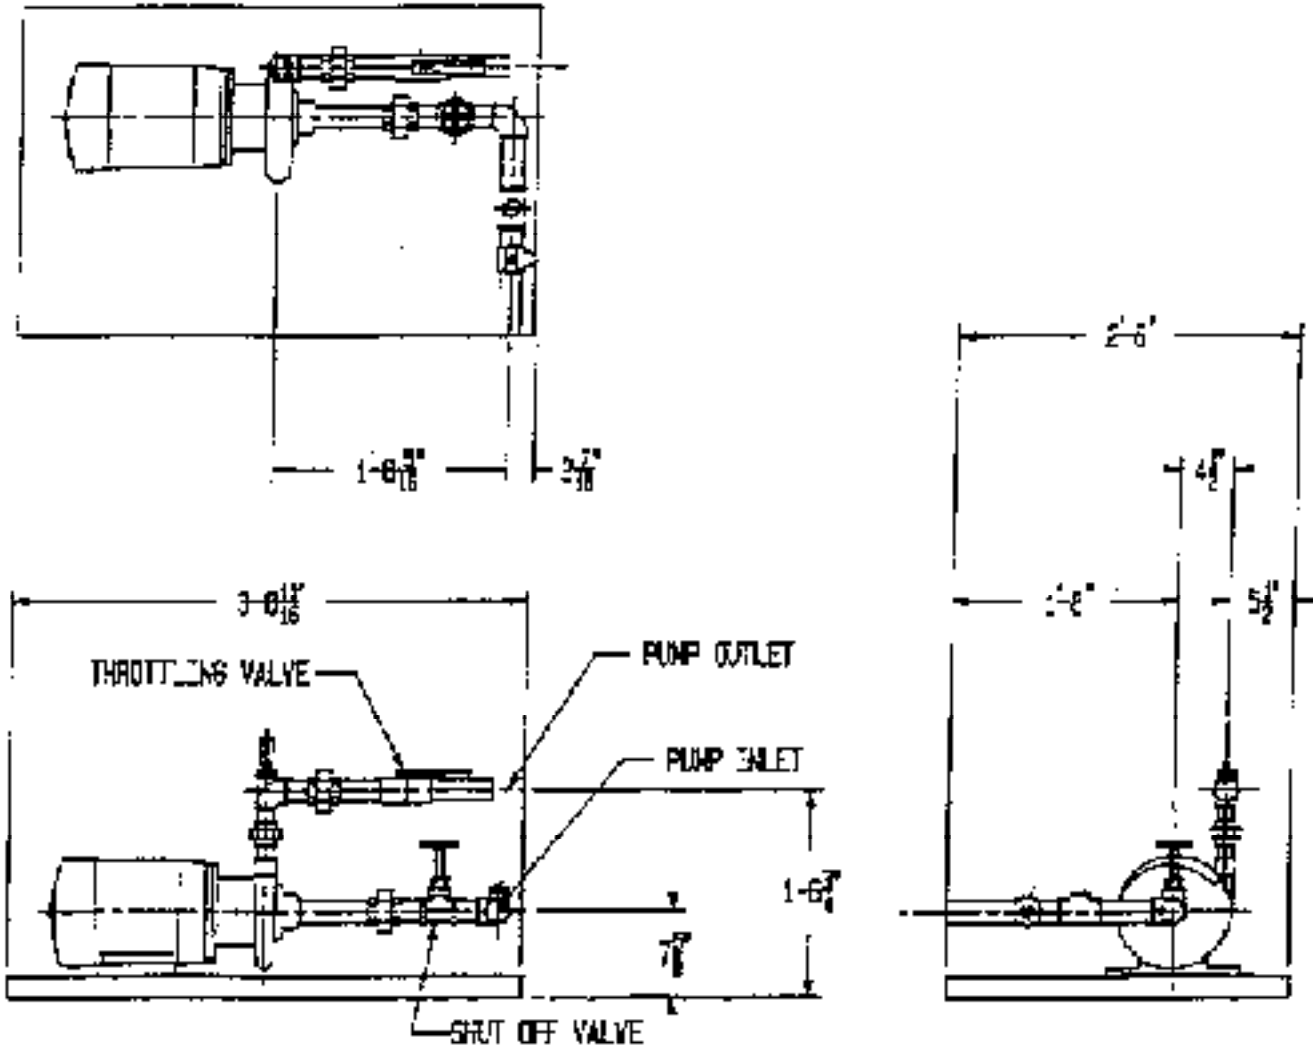

Do not use for construction purposes.